



## High Impedance Fault Detection on Rural Electric Distribution Systems

*Anjana Tripathi and Anil Kumar Kori*

*Department of Electrical Engineering,  
Jabalpur Engineering College, Jabalpur, (MP)*

*(Received 05 November, 2013 Accepted 27 December, 2013)*

**ABSTRACT:** A high impedance fault (HIF) results when an energized primary conductor comes in contact with a quasi-insulating object such as a tree, structure or equipment, or falls to the ground. The significance of these previously undetectable faults is that they represent a serious public safety hazard as well as a risk of arcing ignition of fires. A high impedance fault [1] is characterized by having impedance sufficiently high that it is not detected by conventional over current protection, such as fuses and over current relays. Unlike low impedance short circuits, which involve relatively large fault currents and are readily detectable by conventional over current protection, these HIFs represent little threat of damage to power system equipment. High impedance faults produce current levels in the 0 to 50 ampere range. Typically, an HIF exhibits arcing and flashing at the point of contact. Throughout the utility industry, there have been differences of opinion on how often HIFs occur. Normally, utilities do not keep good records on the number of down conductor instances.

**Keywords:** Power line, arcing high impedance fault, Transient analysis, harmonics, over current devices, detection of high,

### I. INTRODUCTION

This is a status report to the Line Protection Sub-Committee of the PSRC on the applications of high impedance fault detection technology. Not all unsafe conditions involve a HIF, i.e. a sagging conductor. This paper does not address the detection of those abnormal conditions where a conductor breaks and does not contact either another conductor or a grounded element [5]. A high impedance fault (HIF) does not have to involve a path to ground and, in fact, whether a ground is involved does not matter to the HIF detector. A high impedance fault can exist between two phase conductors (a tree limb lying across two phase conductors). The majority of HIFs do involve ground. In this discussion, high impedance faults will be referred to as HIFs whether or not ground is involved. A high impedance ground fault results when a primary conductor makes unwanted electrical contact with a road surface, sidewalk, sod, tree limb, or with some other surface, or object which restricts the flow of fault current to a level below that reliably detectable by conventional over current devices. Often this leaves a conductor energized on [9] the ground surface posing a danger to the public. The nature of HIFs has been studied since the early 1970's with the hope of finding some characteristic in the current or voltage waveform that would make detection possible and practical. It is seldom recorded on trouble reports unless it results in a fuse or breaker operation. While it is likely that only a few percent (5-20%) of all distribution faults are high impedance faults, means exist to detect a high percentage of HIFs. The detection of high impedance faults on rural electrical distribution systems has been one of the most persistent and difficult problems facing the electric utility industry. Advances in digital technology have enabled practical solutions for the detection of a high percentage of these previously undetectable faults.

This paper will review several methods of detecting high impedance faults. The issues and application of this technology will also be discussed. Field experience using digital technology will be also reviewed.

### II. HISTORY HIGH IMPEDANCE FAULT DETECTION

Energy demand in the pre-industrial world was provided mostly by man and animal power and to a limited extent from the burning of wood for heating, cooking and smelting of metals. The discovery of abundant coal, and the concurrent technological advances in its use, propelled the industrial revolution. [4] Steam engines, mechanized production and improved transportation, all fuelled directly by coal, rapidly followed. The inter war years saw the rise of oil exploration and use. Access to this critical fuel became a key issue during the Second World War. Post - war industrial expansion and prosperity was increasingly driven by oil, [8,9] as was the massive growth in private car use. More recently a new phase of economic growth has been underpinned to a great extent by natural gas. A substantial proportion of coal and gas production is used to generate electricity, which has been widely available now for over a century. Electricity is a premium form of energy due to its flexibility and ease of distribution. Demand worldwide is growing, driven by the explosion in consumer electronics, the associated [11-13] industrial activity and the widening of access to consumers in the developing world. Detection of downed power lines is a long-standing problem to electric utilities. High impedance faults result in very low currents which are often not detectable by conventional overcurrent relays. A HIF occurs, for example, when a conductor breaks and falls on a non-conducting surface such as asphalt road, sand, grass or a tree limb producing a very small current.

These faults are difficult to detect when the impedance at the point of fault is high enough to limit the fault current to the region unprotected by conventional over current devices (Fig. 1). When no solid return path for the current is available, the fault exhibits arcing phenomena; these faults are then referred to as "high impedance arcing faults". HIFs are a dangerous phenomenon since risks of electric shocks are posed to the public and fire hazard also exist. It is estimated that majority of electrically caused fires are due to arc type, hot neutral intermittent faults [1]. Therefore, the principal motivation in high impedance fault detection is not just system protection, but to improve safety. The threshold of overcurrent relays must be set at a relatively high current level to prevent tripping by inrush currents thereby causing unnecessary service interruption. Most detection schemes involve the adjustment of the existing over current protection to be more sensitive by lowering its setting. Such scheme have failed to operate in 32% of high impedance faults and lead to several unexpected service interruptions [1].

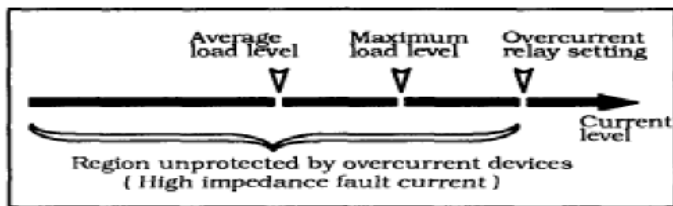


Fig.1. Relation of high impedance fault current to over current.

In the past two decades many techniques have been proposed to improve the detection of HIFs in power distribution systems, and recently the utilities have intensified research programs searching for more efficient protection against this type of a fault. Some of the techniques used to deal with this problem are mechanical methods where various mechanical devices are used to provide a low impedance fault by catching the fallen conductor [2]. Others have used electrical methods and techniques

### III. ARC CURRENT NATURE

An arc is defined as a luminous electrical discharge flowing through a gas between two electrodes. In the case of an arcing HIF, when an energized conductor touches the ground, the electric contact is not solid. Due to the existence of air between the ground and the conductor, the high potential difference across a short distance excites the appearance of an arc. Many authors have worked on the theory and dynamics of voltages and currents in an electric arc, most such studies are experimentally based. In [15] and later in [16] a model explaining the phenomenon using a spark gap was proposed. This air gap will not conduct till the applied voltage reaches the breakdown point. Then the current flows and reaches a maximum when the applied voltage equals the arc voltage. After that, the arc current decreases and becomes zero, i.e. the arc is extinguished.

When extinction occurs, the arc requires a potential, known as restrike voltage, to reignite. This reignition will have the opposite polarity. This explains the typical voltage-current waveform of an arc shown in Fig. 2. Many electric models have been proposed describing arc behaviour as reviewed by [17].


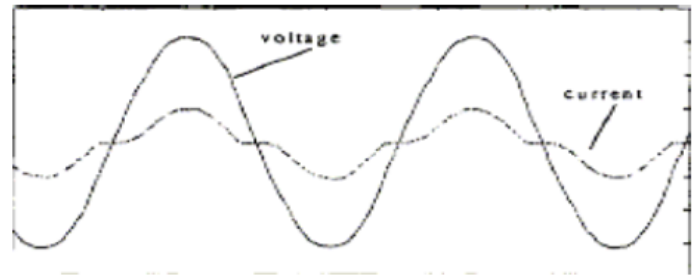


Fig. 2. Electric arc voltage and current shapes.


In the context of downed conductors, Russell [18] conducted staged HIF tests studying dependencies of arc current magnitude on potential difference, gap distance, [6] features of the grounding surface and environmental conditions of the grounding point. A high degree of random behaviour was observed due to impurities near the grounding point, heat from the arc that is intense enough to fuse substances and the evolution of different paths for current flow on surfaces. accurately modelled so far. Some previous researchers have reached a consensus that HIFs are nonlinear and asymmetric, and that modelling should include random and dynamic qualities of arcing. Emanuel et al [19] suggested two dc sources connected anti parallel with two diodes to simulate zero periods of arcing and asymmetry. Yu et al [20] used combinations of nonlinear resistors, while Wai et al [21] introduced a sophisticated TACS switch controlling the open/closed loop of a HIF to introduce nonlinearity and asymmetry. In this paper, a more dynamic and random HIF model is applied. It combines most of the advantages of the previous models proposed while remaining simple and universal; it was first put forward by the authors in [22]. The high impedance fault model proposed in [22] is shown in Fig. 3 and includes two DC sources,  $V_p$  and  $V_n$ , which represent the arcing voltage of air in soil and/or between trees and the distribution line; two resistances,  $R_p$  and  $R_n$ , between diodes, which represent the resistance of trees and/or the earth resistance; and since most observed arcs occur in highly inductive circuits [2] two inductances,  $L_p$  and  $L_n$ , added to the circuit. The effect of the inductances leads to the nonlinearity loop in the V-I curve and the desired asymmetrical shape for the HIF current. When the line voltage is greater than the positive DC voltage  $V_p$ , the fault current starts flowing towards the ground. The fault current reverses backward from the ground when the line voltage is less than the negative DC voltage  $V_n$ .

In the case when the line voltage is in between  $V_p$  and  $V_n$ , the line voltage is counterbalanced by  $V_p$  or  $V_n$  so that no fault current flows. As a direct result of the presented model the typical high impedance fault current and V-I curves were produced and are shown in Figures



**Fig. 3.** A two diode fault model for a HIF containing  $R_n$ ,  $R_p$ ,  $L_n$ ,  $L_p$ .

When a conductor is left energized on the ground, it represents an increased hazard to the public in the immediate vicinity of the downed wire. Therefore, the solution appears to be obvious - employ HIF detection and clear [14] the circuit immediately for such conditions. Unfortunately, the decision is not that simple. No device, overcurrent or otherwise, can protect from initial electrical contact. The type of HIF detection currently available is relatively slow. Therefore, its ability to prevent and protect against an injury resulting when the downed conductor event and the occurrence of electrical contact close together is limited.

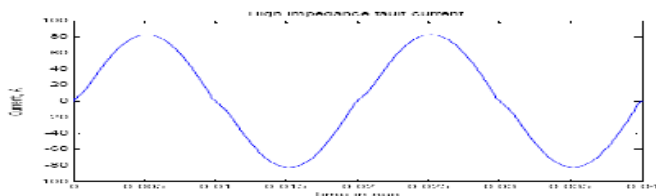

**Fig.4.** Current curve for HIF.

#### IV. THE HARMONIC MODEL

A signal can be defined as a function that carries information, usually about a state or a procedure of a physical system. However, signals can be represented in several ways. Mathematically, a periodic and distorted signal can be suitably represented in terms of its fundamental frequency and harmonic components, [16] expressed as a sum of sinusoidal waveforms referred to as the Fourier series. Each frequency is an integer multiple of the fundamental system frequency. In order to obtain an approximation of such waves, mathematical models are employed. Consider a current waveform with harmonic components, written as [22]

#### V. CONCLUSION

A new method for high impedance fault detection is proposed. The problem is formulated as an estimation task and a Real simlink model is used to solve this optimization problem. The method was successfully tested on tracking harmonics and current angles associated with HIF. The very accurate results obtained show that the proposed approach can be used as a very reliable method of identifying high impedance faults.

#### REFERENCES

- [1]. Application of High Impedance Fault Detectors" Panel session at 1995 PES Summer Meeting. J.J. Burke - Power Technologies, Inc., E.E.Baker - Florida Power Corp., B.D.Russell - Texas A&M University, R.H.Jones - Rochester Gas & Electric Co., Tom Wiedman - Commonwealth Edison Co., N.Johnson - PacifiCorp, J.T.Tengdin - Consultant, Chairman.
- [2]. Arcing Fault Detection for Distribution Feeders: Security Assessment in Long Term Field Trials" B.D.Russell, C.L.Benner IEEE Transactions on Power Delivery April 1995 Volume 10, Number 2, pp 676-683.
- [3]. High Impedance Fault Implementation Issues" B.M.Aucoin, R.H.Jones IEEE Transactions on Power Delivery, January 1996, Volume 11, Number 1, pp 139-148.
- [4]. Relay Detects Down Wires By Fault Current Harmonics" J.Reason, Electrical World, Vol. 208, No. 12 December 1994 pp 58-59.
- [5]. Distribution Line Protection Practices - Industry Survey Results" PSRC Committee Report IEEE T&D Conference April 1994 94CH3428-0 pp 291-301.
- [6]. A Microprocessor-Based Digital Feeder Monitor with High Impedance Fault Detection" W.Tyska, B.D.Russell, B.M.Aucoin 47th Annual Texas A&M Relay Conference March 21-23, 1994.
- [7]. Down Conductor Detection: Theory and Practice" Jeerings and Linders - PSRC/IEEE Vancouver BC Section Conference on Downed Conductors May 1993.
- [8]. The Challenge To Improve Safety" Public Utilities Fortnightly Vol.129, No.3 pp 38-40 Feb 1, 1992.
- [9]. An Artificial Neural Network Approach to the Detection of High Impedance Faults" A.P.Apostolov, J.Bronfeld, C.H.M.Saylor, P.B.Snow EPRI Conference on Artificial Intelligence Applications in Power Systems, Dallas TX December 1992.
- [10]. A Practical Protective Relay For Down Conductor Faults" Jeering and Linders PWRD Vol. 6, No. 2, pp 565-574, April 1991.
- [11]. Performance Testing of the Nordon High Impedance Ground Fault Detector on a Distribution Feeder" 34th Rural Electric Power Conference IEEE/IAS April 29 - May 1, 1990 Orlando FL.

- [12]. High Impedance Fault Arcing On Sandy Soil In 15 kV Distribution Feeders: Contributions to the Evaluation of the Low Frequency Spectrum" Emanuel & Gulachenski, *IEEE Trans. on Pwr Deliv PWRD* Vol. 5, No. 2, pp 676-84 April 1990.
- [13]. Unique Aspects of Distribution System Harmonics Due To High Impedance Ground Faults" Jeerings and Linders, *PWRD* Vol. 5, No. 2, pp 1082-92, April 1990.
- [14]. Classification of Faults and Switching Events by Inductive Reasoning and Expert System Methodology" C.J.Kim, B.D.Russell *IEEE Transactions on Power Delivery PWRD* Vol. 4, No. 3, pp 1631-37 July 1989.
- [15]. Detection of Downed Conductors on Utility Distribution Systems" *IEEE PES Tutorial Course 90EH0310-3-PWR* 1989 (blue book).
- [16]. Downed Power Lines: Why They Can't Always Be Detected" *IEEE Power Engineering Society Public Affairs Document* February 1989 (green book).
- [17]. A Neural Network Approach to the Detection of Incipient Faults on Power Distribution Feeders" S. Ebron, D.L. Lubkerman, M. White *IEEE T&D Conference, New Orleans LA, 1989* 89 TD 377-3 PWRD.
- [18]. Ground Resistance Revisited" Jeerings and Linders, *IEEE Transactions on Power Delivery PWRD* Vol. 4, No. 2, pp 949-956, April 1989.
- [19]. Performance Testing of the Ratio Ground Relay on a Four-Wire Distribution Feeder" R.E.Lee, M.T.Bishop, *IEEE Trans on Pwr Apparatus and Systems*, Sept 1983.
- [20]. Detection of Arcing Faults on Distribution Feeders" Texas A&M University, B.D. Russell, B.M. Aucoin, T.J. Talley, *EPRI Final Report EL-2767*, December 1982.
- [21]. High Impedance Fault Detection Using Third Harmonic Current" Hughes Research Laboratories, I.Lee, *EPRI Final Report EL-2430*, June 1982.
- [22]. Detection of High Impedance Faults" Power Technologies, Inc. S.J. Balser, K.A. Clements, E. Kallauer, *EPRI Final Report EL-2413* June 1982.